

## RCP 40: Damper control unit

### How energy efficiency is improved

Enables the implementation of individually optimised controls for maximum efficiency in pneumatic installations.

### Areas of application

Activation of a temperature-dependent outside-air/return-air damper in combination with a transducer in ventilation and air-conditioning equipment. Control of the mixed-air temperature with two separate transducers, e.g. in winter operating mode.

### Features

- Control of fresh air damper, depending on trapezium diagram for the outdoor temperature
- Housing, rack and front doors made of thermoplastic
- Suitable for wall or panel mounting
- Functional description and commissioning help inserted in front door
- Front panel with adjusters and 3 covered recesses for plug-in pressure gauge (XMP) making commissioning easier
- All settings very easy to make with a coin and % scale
- M4 measuring connections, control action adjustable (delivered with control action B)
- Compressed-air connections Rp 1/8" female thread
- Complies with directive 97/23/EC Art. 3.3 on pressure equipment

### Technical description

- Supply pressure 1.3 bar  $\pm$  0.1
- Easily accessible adjusters for KP3+5 (schedule start point), XP3+5 (P range)
- Inputs for:
  - control action
- Outputs for:
  - output pressure for damper drive

Type	Description	Air Capacity l/h	Air consumption <sup>1)</sup> l/h	Weight kg
<b>RCP 40 F001</b>	trapezium diagram	400	70	0,7
Supply pressure <sup>2)</sup>	1,3 bar $\pm$ 0,1	Permissible amb. temp.		0...55 °C
Input pressures	0,2...1,0 bar	Connection diagram		<a href="#">A02692</a>
Output pressures	0,2...1,0 bar	Dimension drawing		<a href="#">M297100</a>
Shift starting pt. KP <sub>3</sub> , KP <sub>5</sub>	0...100%	Fitting instructions		<a href="#">MV 3247</a>
P-band X <sub>P3</sub> , X <sub>P5</sub>	0...100%			
Minimum limiter B	0...100%			

### Accessories

**0297103 000** Additional bag of scales with 8 different scales according to the transducer used.

**0297133 000** Universal scales for setpoint adjuster X<sub>S</sub>; gradation 120, 80/160, 50/100, 30/60

1) Without transducer; air consumption for transducer connections 3 and 5 is 33 l/h more in each case.

2) See Section 60 on regulations concerning the quality of supply air, especially at low ambient temperatures.

### Operation

The pressure at connections 3 and 5 is fed in each case to an amplifier with variable shift starting point KP (zero point) and variable P-band X<sub>P</sub> (amplification). The amplifier at input 3 has control action A; the one at input 5 has control action B. Due to the following minimum selection, the smaller of the two amplifier outputs is always passed on. This forms a trapezoidal characteristic which can be rotated at the KP points (at 0 bar). Both characteristics are limited to a (variable) minimum value by the following limiter B.


In its main use, a transducer is fed to both inputs, e.g. for the control of a fresh-air damper dependent on outside temperature (trapezium diagram).

The fresh-air damper can also be controlled with dependency on two separate transducers, e.g. damper control dependent on outside temperature in summer, and control of the mixed-air temperature in winter.


A restrictor ( $\varnothing$  0,2 mm) for supplying the transducer is fitted at connection 3. If a second transducer is connected to connection 5, then a separate restrictor ( $\varnothing$  0,2 mm) is needed. The signals from the transducer (connections 3 and 5) and the output pressure can be checked via the M4 measuring connection or indicated via the manometer.



T03055



Y03247



B03259

Additional details

Front plate with adjusters for P-bands ( $X_{P3}$ ,  $X_{P5}$ ), shift starting point (KP3, KP5) and limitation (B).

Additional information on accessories


0297103 000 Additional bag of eight alternative scales  
5...35 °C 20...90 %rh  
-20...40 °C 0...5 mbar  
0...120 °C 5...10 mbar  
80...200 °C 10...15 mbar

Technical information


Technical manual: centair system 304991 003

Connection diagrams

Damper control for summer and winter

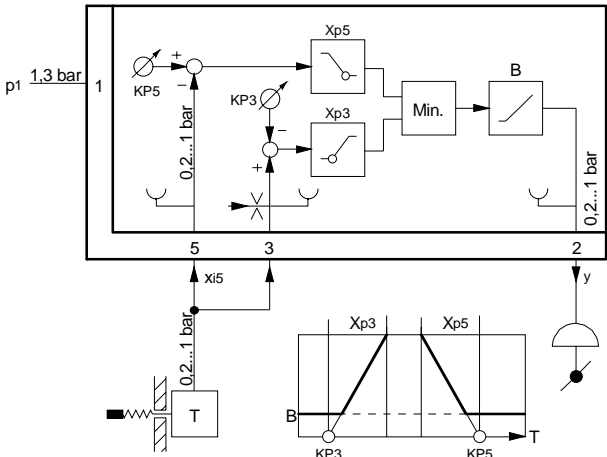

Open-loop control in summer, closed-loop control in winter

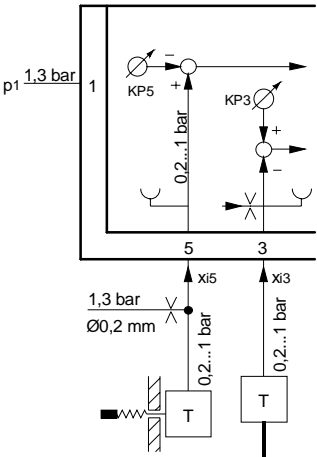

A02692

1	Supply pressure	KP3	Shift starting point, summer	B	Minimum limiter
2	Output pressure	KP5	Shift starting point, winter	$x_{i3}$	Mixed-air temperature
3	Input for control action A (winter)	$X_{P3}$	P-band, summer	$x_{i5}$	Outside temperature
5	Input for control action B (summer)	$X_{P5}$	P-band, winter	y	Output pressure

Dimension drawing

